


# Industrial-Duty Hoist Operator Specifications

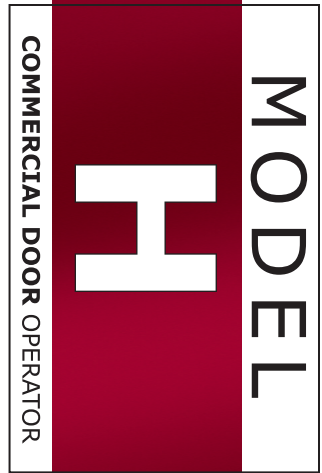

## PART 1 GENERAL

### 1.1 SECTION INCLUDES

- A. Hoist-type door operators for rolling doors, shutters, and grilles.

### 1.2 RELATED SECTIONS

- \*\* Note to Specifier: Please list all applicable CSI Masterformat Sections requiring coordination to Automatic Door Operators.

### 1.3 REFERENCES

- \*\* Note to Specifier: Please list all applicable Standards, Codes and other Reference documentation related to the design, functionality, installation and performance of Automatic Door Operators.

### 1.4 SUBMITTALS

- \*\* Note to Specifier: Please list all applicable submittal requirements required for approval.

### 1.5 DELIVERY, STORAGE, AND HANDLING

- \*\* Note to Specifier: Please list all applicable delivery, storage and handling requirements for Automatic Door Operators that are pertinent to the project site and conditions.

### 1.6 WARRANTY

- A. Manufacturer's standard 2-year warranty against material and manufacturing defects.

## PART 2 PRODUCTS

### 2.1 MANUFACTURERS

- A. Industrial-Duty Operator: Continuous-duty, high-starting torque motor with overload protection and an emergency chain hoist with electric interlock; Model H; Chamberlain, Elmhurst, IL.

- 1. Electric Operator: Model H industrial-duty assembly, cULus Listed and cULus Labeled, with electric motor and factory-wired motor controls. positive locking mechanical system acting as a holding brake, manually operated chain hoist, 3-button OPEN/CLOSE/STOP control station, conduit-encased wiring from control circuit to motor, positive locking mechanical system acting as a holding brake, and accessories required for proper operation; door speed of approximately 8 inches (203 mm) to 9 inches (229 mm) per second.

- a. Drive Reduction: Heavy-duty 5L V-belt primary reduction and chain/sprocket secondary and third stage reduction; all reduction sprockets and pulleys shall be drilled and pinned to steel shafts plated for resistance to corrosion; operator shall be equipped with permanently lubricated ball bearings on output shaft, adjustable friction clutch and output and door driven sprockets.
- b. Limit Switches: Fully adjustable, driven linear-type switch mechanism synchronizing operator with door; low friction nylon limit nuts fitted on treaded steel shaft that rotates on oil-tight self-lubricating bronze bushings; motor shall be removable with affecting limit switch settings.
- c. Electric Motor: High-starting torque, continuous-duty, industrial-type protected against overload by current sensing and thermal overload devices.

- 1) Motor Specification (NOTE TO SPECIFIER: select one of the following):
  - (a) 115V-60Hz-1Phase; 1/3, 1/2, 3/4 or 1HP
  - (b) 230V-60Hz-1 Phase; 1/3, 1/2, 3/4 or 1HP
  - (c) 208/230V-60Hz-3 Phase; 1/3, 1/2, 3/4 or 1HP
  - (d) 460V-60Hz-3 Phase; 1/3, 1/2, 3/4 or 1HP
  - (e) 575V-60Hz-3 Phase; 1/3, 1/2, 3/4 or 1HP

- d. Motor Control and Enclosure: LiftMaster LOGIC 4.0 motor control shall be UL approved microprocessor solid-state type and shall include the capability to select one of seven wiring types; additional features shall include a maintenance alert diagnostic system, programmable timer-to-close w/ timer defeat input, mid-stop programming capabilities and a maximum run timer to provide motor overrun protection; motor control shall be housed in a NEMA 1 enclosure integral to the operator and shall conform to ANSI/NEMA ICS6.

- 1) Radio Receiver: LiftMaster LOGIC 4.0 on-board, 3-channel receiver with standard external antenna; equipped to accept Security+ Rolling Code Technology remote transmitters and Trinary Dip Switch remote transmitters, with memory for up to 23 Security+ remote transmitters or an unlimited number of Trinary Dip Switch remote transmitters.

- e. 3-Button Control Station: 3-button station providing OPEN/CLOSE/STOP functionality shall be NEMA Type 1 with maintenance alert indicator to signal intervals for routine door and operator maintenance.

- f. Door Drive: Full #50 roller chain; operator shall be equipped with an electrically interlocked, floor level disconnect and chain hoist for manual operation.

- g. Optional Operator Modifications (NOTE TO SPECIFIER: select only if applicable)
  - 1) Electric solenoid-actuated brake capable of stopping and holding a door at any position.
- 2. Primary Entrapment Protection Safety Devices  
\*\*NOTE TO SPECIFIER\*\* for any type of operating mode other than constant contact on the 'Close' button of the 3-button station to lower the door, one of the following UL-Approved and UL-Listed Monitored Entrapment Protection safety devices must be connected directly to the Logic 4 operator; select one of the following):

- a. Industrial/Commercial Monitored Photo Sensors: CPS-U fully monitored, non-contact, infrared beam photo sensor system shall reverse, in conjunction with the Logic 4 operator, a closing door to the full open position when an obstruction is sensed; photo sensors shall be mounted no higher than 6" maximum above the floor.
- b. NEMA 4 Monitored Photo Sensors: CPS-UN4 fully monitored, non-contact, infrared beam reversing photo sensor system, with NEMA 4 watertight enclosure shall reverse, in conjunction with the Logic 4 operator, a closing door to the full open position when an obstruction is sensed; photo sensors shall be mounted no higher than 6" maximum above the floor.
- c. Monitored Sensing Edge Interface: CPS-EI edge interface shall provide a means to attach a 4-wire monitored sensing edge to a Logic 4 operator for continuous monitoring purposes; the edge, in conjunction with the Logic 4 operators shall reverse a closing door to the full open position when an obstruction is sensed; sensing edge supplied by others.
- 3. Ancillary Entrapment Protection Safety Devices  
\*\* NOTE TO SPECIFIER\*\* Ancillary Entrapment Protection safety devices are optional and can be used to supplement, but not replace, Primary Entrapment Protection safety devices; select one of the following):
  - a. Retro-Reflective Photo Sensors: CPS-RN4 non-monitored, non-contact, infrared beam photo sensor with polarized reflector for use in conjunction with the CPS-EI edge interface and monitored 4-wire sensing edge; shall reverse a closing door to the full open position when an obstruction is sensed; photo sensor shall be mounted no higher than 6" maximum above the floor.
  - b. Non-Monitored Electric Sensing Edge: 2-wire non-monitored electric edge shall reverse a closing door to the full open position when an obstruction is sensed
  - c. Pneumatic Sensing Edge: Pneumatic (air hose) sensing edge shall reverse a closing door to the full open position when an obstruction is sensed.

## PART 3 EXECUTION

### 3.1 EXAMINATION

- \*\* Note to Specifier: Please list all requirements regarding examination of the Substrate to which Automatic Door Operators will be mounted.

### 3.2 PREPARATION

- \*\* Note to Specifier: Please list all requirements regarding preparation of the Substrate to which Automatic Door Operators will be mounted.

### 3.3 INSTALLATION

- A. Install in accordance with manufacturer's instructions.

### 3.4 PROTECTION

- A. Protect installed products until completion of project.
- B. Touch-up, repair or replace damaged products before Substantial Completion.

Customer \_\_\_\_\_


Project \_\_\_\_\_

Architect/Engineer \_\_\_\_\_

Contractor \_\_\_\_\_

Drawing Number \_\_\_\_\_ Date \_\_\_\_\_ Sheet \_\_\_\_\_ of \_\_\_\_\_

### SHOP DRAWING

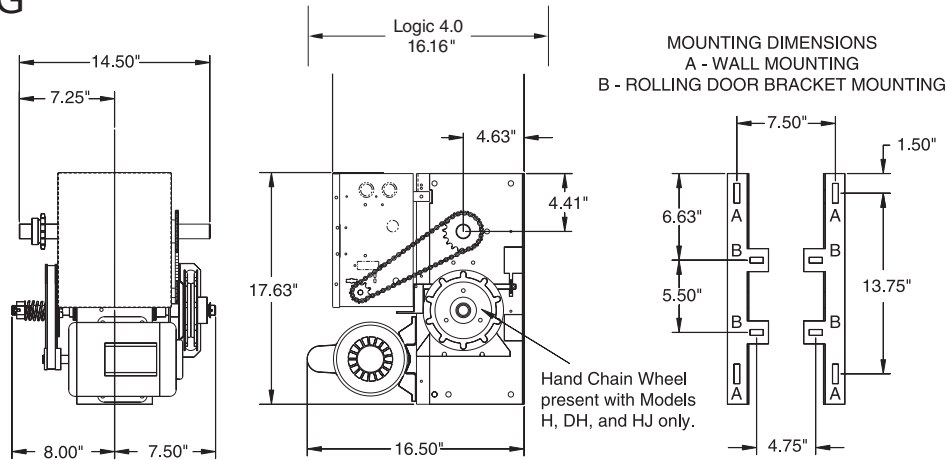

### Specifications for Ordering

1) Supply \_\_\_\_\_ ( ) LiftMaster Operator(s) Model \_\_\_\_\_  
 \_\_\_\_\_ HP, \_\_\_\_\_ Volts, \_\_\_\_\_ Phase, \_\_\_\_\_ Hertz \_\_\_\_\_

2) For \_\_\_\_\_ wide x \_\_\_\_\_ high door(s) with \_\_\_\_\_

3) Supply \_\_\_\_\_ ( ) OPEN/CLOSE/STOP control station(s) in NEMA \_\_\_\_\_ enclosure per operator

4) Supply auxiliary and optional equipment as specified below (one per operator unless otherwise noted)

Additional Info

### Notes:

- 1) Refer to Model H product data sheet for general information
- 2) Refer to drawing \_\_\_\_\_ for wiring diagram

Manufactured by:  
 The Chamberlain Group, Inc.  
 845 Larch Avenue • Elmhurst, Illinois 60126  
**For More Information:**  
 call (800) 323-2276  
 visit [www.liftmaster.com](http://www.liftmaster.com) or  
<http://specs.liftmaster.com/architectscorner>

MOTOR AMPERAGE RATING					
HORSE POWER	VOLTAGE - PHASE - 60Hz				
	115-1Ø	230-1Ø	230-3Ø	460-3Ø	575-3Ø
1/3	6.6	3.3	2.2	1.0	0.8
1/2	8.2	4.1	2.2	1.0	0.8
3/4	11.2	5.6	2.9	1.4	1.2
1	13.6	6.8	3.4	1.7	1.4

# LiftMaster®

Commercial Door Operators